

MINIMUM DIMENSION "B" SHALL BE:
5" FOR PRECAST SECTIONS

PRECASTS CONICAL TOP SECTIONS SHALL BE 4' IN HEIGHT AND SHALL HAVE WALL THICKNESS OF 5" MINIMUM AT BOTTOM AND 7" MINIMUM AT TOP. INTERMEDIATE SECTIONS MAY BE 1'-2'-3'-4' HIGH.

NEW MANHOLE DETAIL


NOT TO SCALE
REMOVE AND REPLACE EXISTING MANHOLE WITH
MANHOLE SECTIONS.



GARY E. BECK, JR.
BUILDING INSPECTOR
ENGINEERING DEPARTMENT
62 CIVIC CENTER PLAZA
POUGHKEEPSIE, NY 12601

TYPICAL
MANHOLE
DETAIL

DATE:
9/22/2014

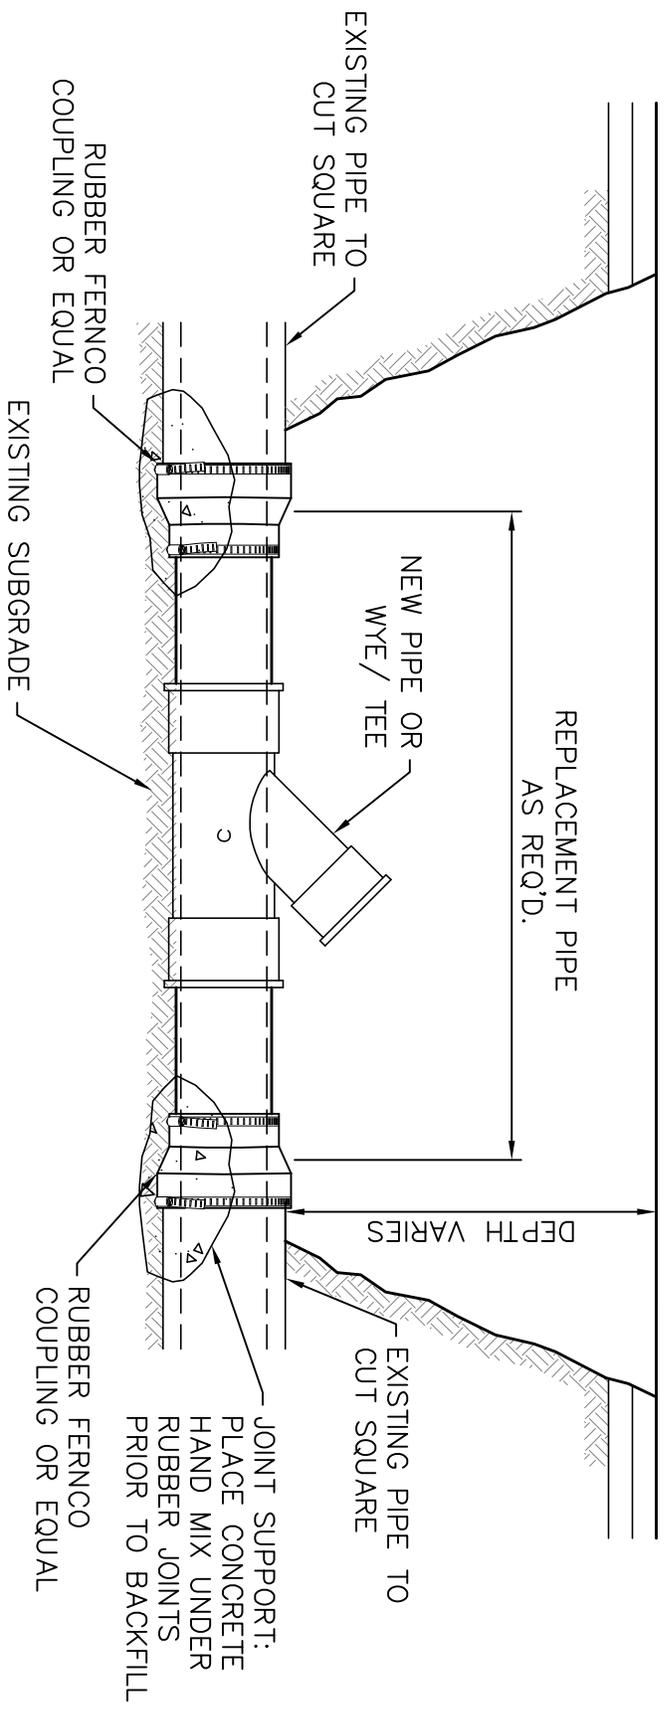

- NOTES:**
1. FOR PIPE GREATER THAN 15" ALL PIPE JOINTS SHALL BE CONSTRUCTED BY METHODS APPROVED BY THE CITY ENGINEER.

TYPICAL SANITARY SEWER PIPE REPAIR OR WYE INSTALLATION DETAIL


SCALE: N.T.S.



TYPICAL SANITARY SEWER PIPE REPAIR OR WYE INSTALLATION DETAIL

GARY E. BECK, JR.
 BUILDING INSPECTOR
 ENGINEERING DEPARTMENT
 62 CIVIC CENTER PLAZA
 POUGHKEEPSIE, NY 12601

DATE:
 9/22/2014

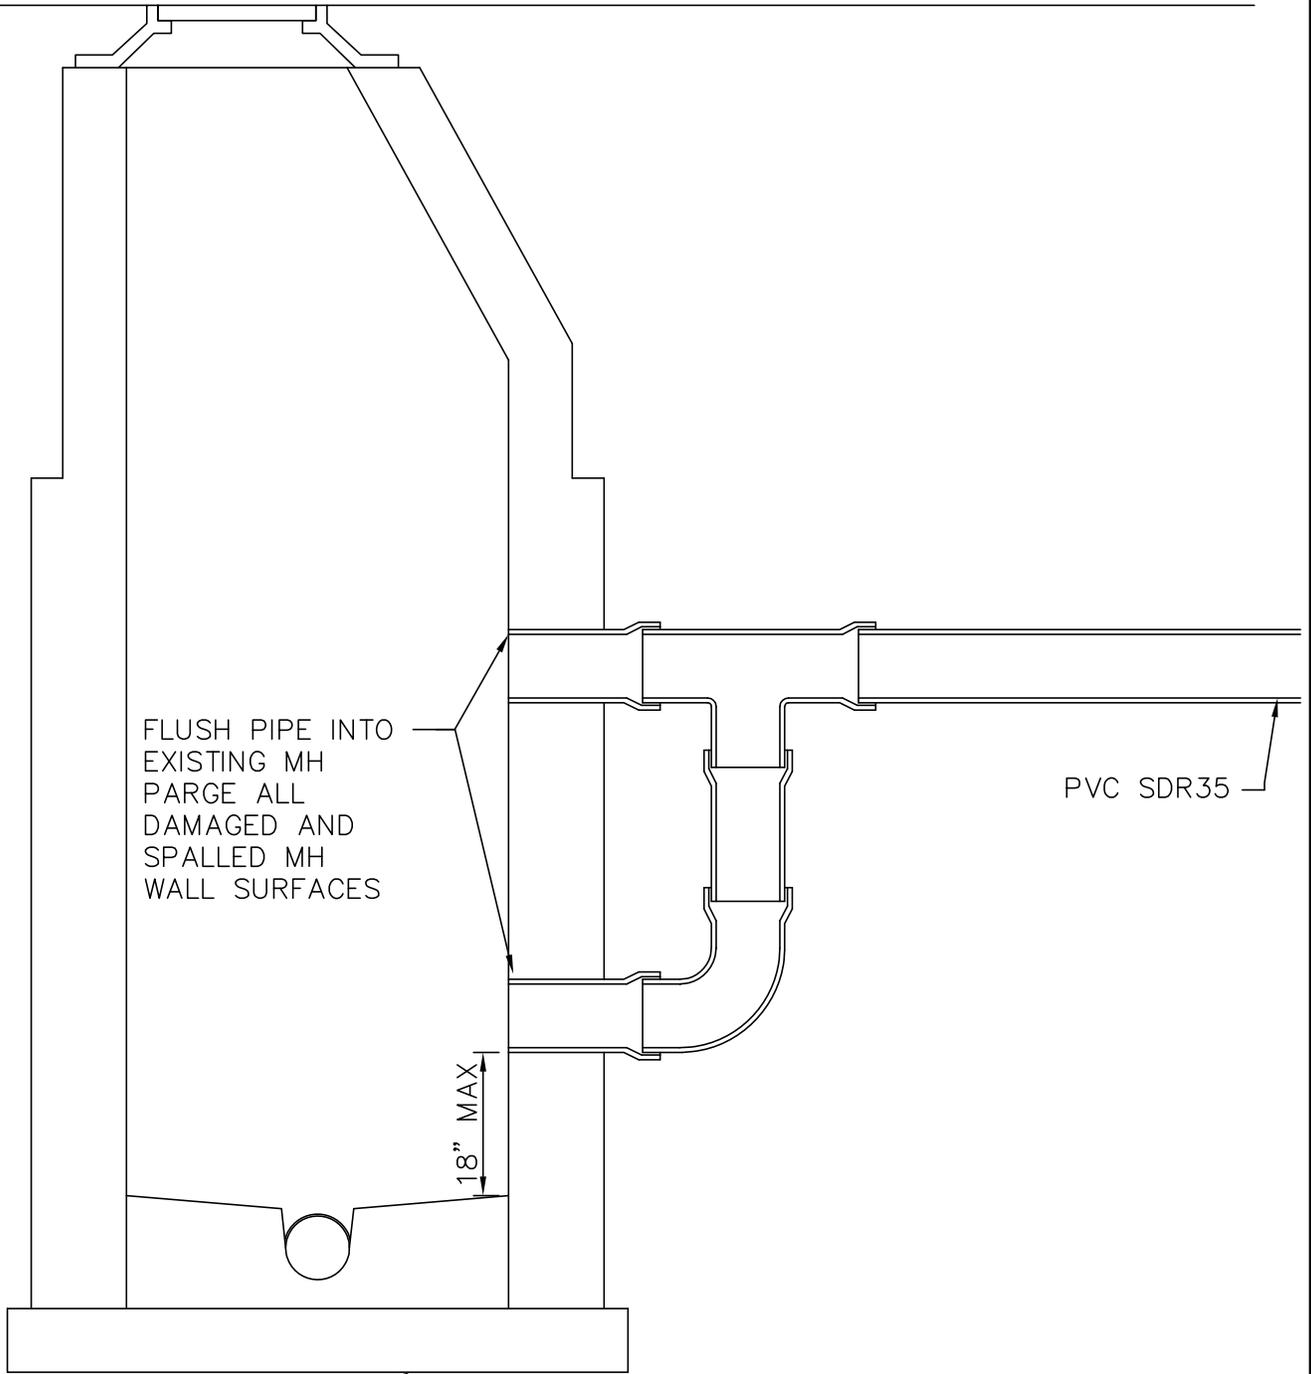

FLUSH PIPE INTO
EXISTING MH
PARGE ALL
DAMAGED AND
SPALLED MH
WALL SURFACES

PVC SDR35

18" MAX

EXISTING MANHOLE

STANDARD DROP CONNECTION

SCALE: 1/2" - 1' - 0"



GARY E. BECK, JR.
BUILDING INSPECTOR
ENGINEERING DEPARTMENT
62 CIVIC CENTER PLAZA
POUGHKEEPSIE, NY 12601

STANDARD
DROP
CONNECTION

DATE:
9/22/2014