





CURB BOX AND SERVICE CONNECTION

GARY E. BECK, JR.
 BUILDING INSPECTOR
 ENGINEERING DEPARTMENT
 62 CIVIC CENTER PLAZA
 POUGHKEEPSIE, NY 12601

DATE:
 9/15/2014

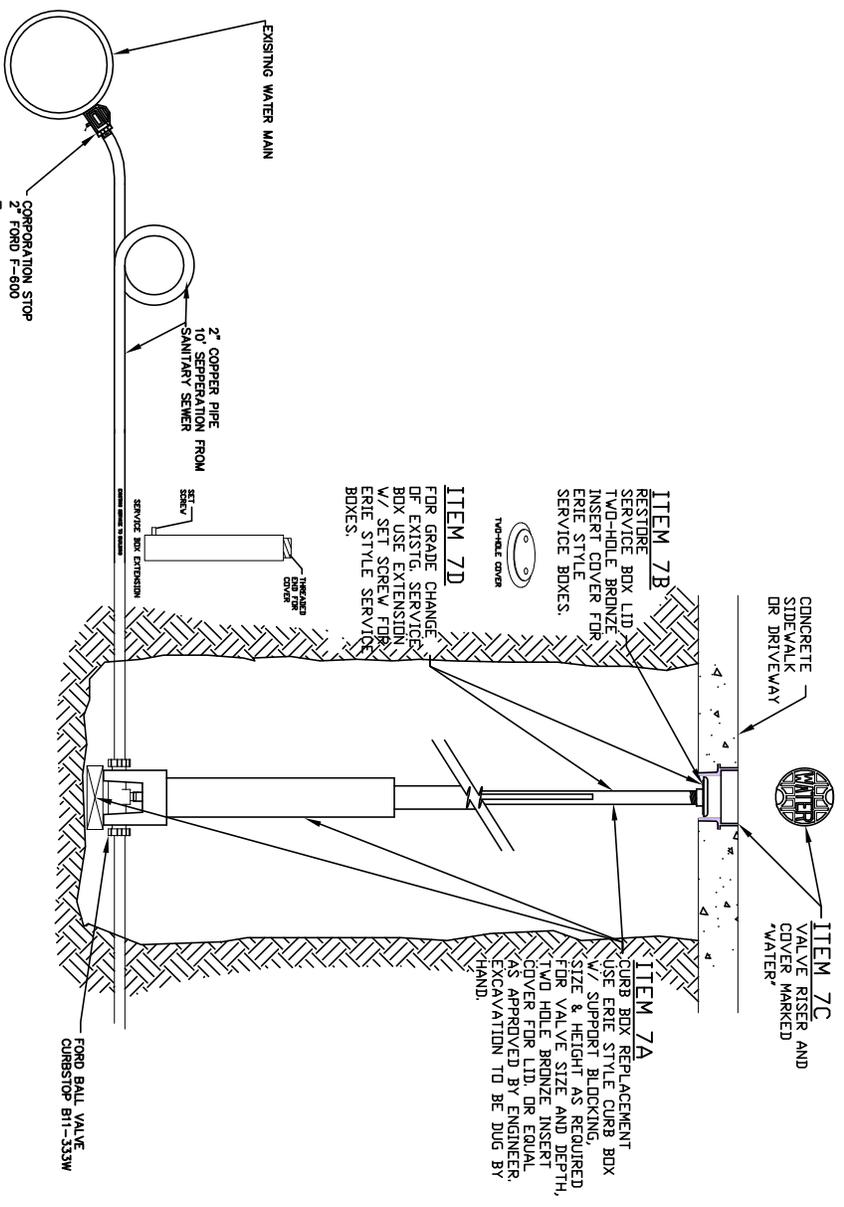

CURB BOX AND SERVICE CONNECTION
 SCALE: N.T.S.

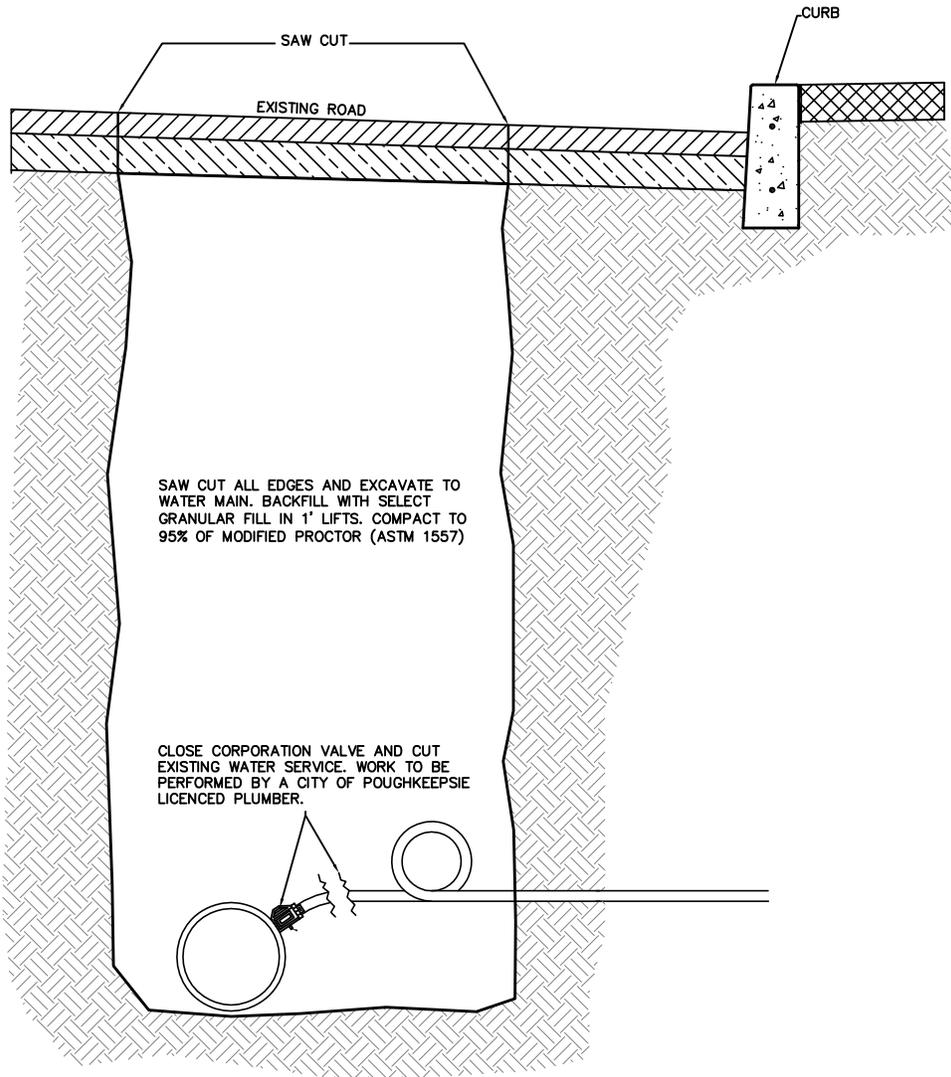


WATER SERVICE DISCONNECT AT MAIN
SCALE: N.T.S.



GARY E. BECK, JR.
BUILDING INSPECTOR
ENGINEERING DEPARTMENT
62 CIVIC CENTER PLAZA
POUGHKEEPSIE, NY 12601

WATER
DISCONNECT
@ MAIN

DATE:
9/15/2014

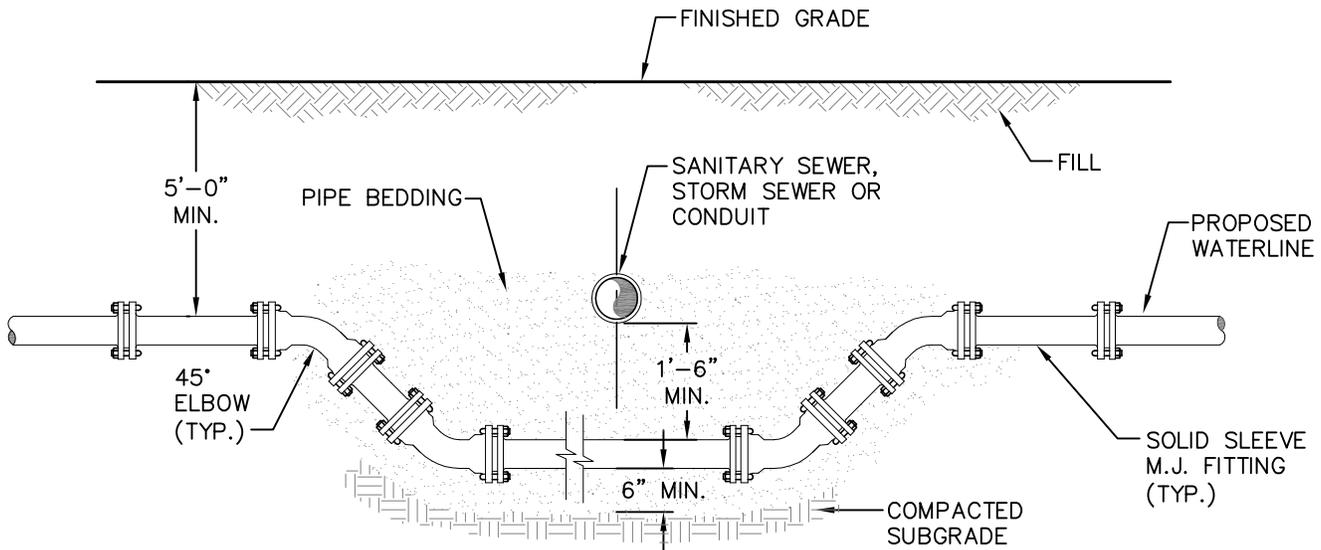

NOTES:

1. WHEN THE ELEVATION OF THE SEWER CAN NOT BE VARIED TO MEET THE ABOVE REQUIREMENTS, THE WATERMAIN SHALL BE RELOCATED TO PROVIDE THIS REQUIRED SEPARATION OR RECONSTRUCTED WITH MECHANICAL JOINT PIPE FOR A DISTANCE OF TEN (10) FEET ON EACH SIDE OF THE SEWER. ONE FULL, UN-CUT LENGTH OF WATERMAIN SHALL BE CENTERED OVER THE SEWER SO THAT BOTH JOINTS WILL BE AS FAR AWAY FROM THE SEWER AS POSSIBLE.
2. WHEN IT IS IMPOSSIBLE TO OBTAIN VERTICAL SEPARATION AS STIPULATED ABOVE, BOTH THE WATERMAIN AND THE SEWERMAIN SHALL BE CONSTRUCTED OF SLIP ON OR OF MECHANICAL PIPE JOINTS, CAST IRON PIPE OR SDR 26 PVC COMPLYING WITH PUBLIC WATER SUPPLY DESIGN STANDARDS OF THE AGENCY AND BE PRESSURE TESTED TO 150 PSI TO ASSURE WATER TIGHTNESS.

WATERLINE OFFSET DETAIL



SCALE: N.T.S.



GARY E. BECK, JR.
 BUILDING INSPECTOR
 ENGINEERING DEPARTMENT
 62 CIVIC CENTER PLAZA
 POUGHKEEPSIE, NY 12601

WATERLINE
 OFFSET

DATE:
 9/15/2014

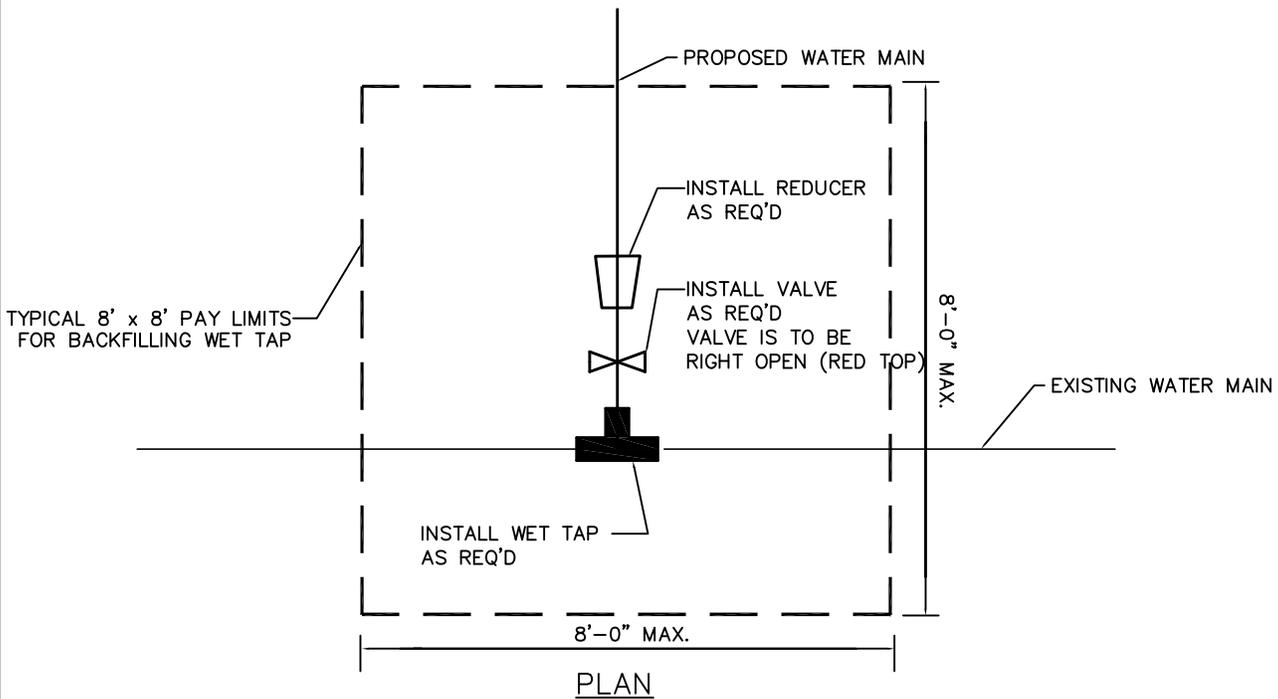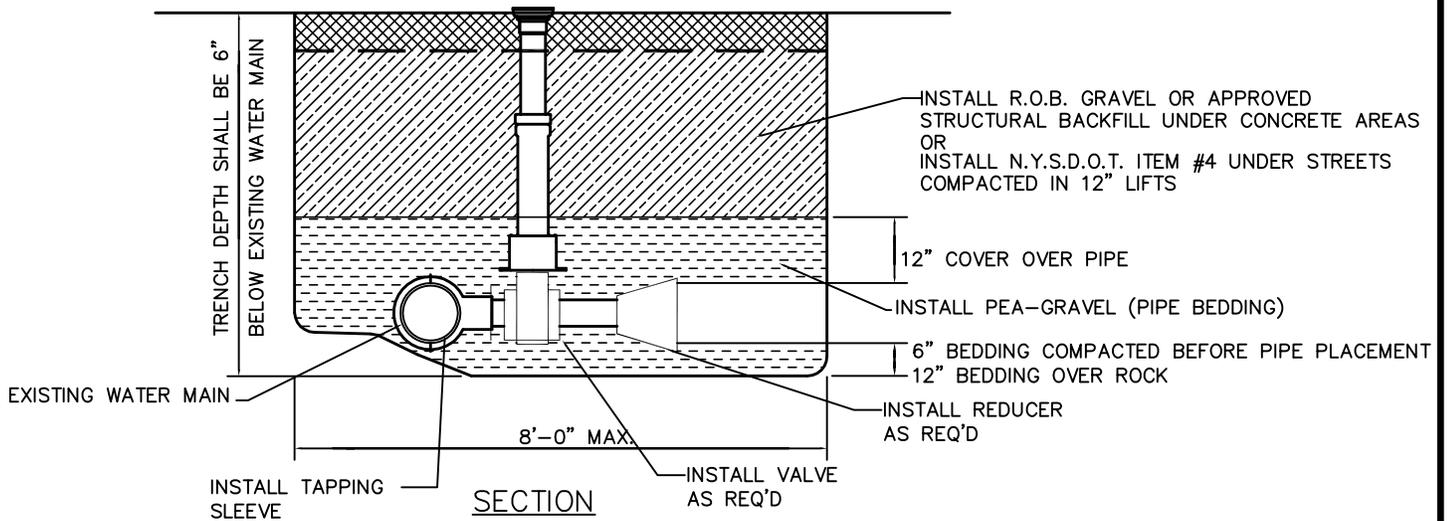

NOTE: ALL BACKFILL TO BE PLACED IN 1' LIFTS AND COMPACTED TO 95% OF MODIFIED PROCTOR (ASTM 1557)

TAPPING SLEEVE & VALVE

SCALE: N.T.S.



GARY E. BECK, JR.
 BUILDING INSPECTOR
 ENGINEERING DEPARTMENT
 62 CIVIC CENTER PLAZA
 POUGHKEEPSIE, NY 12601

TAPPING
 SLEEVE &
 VALVE

DATE:
 9/15/2014